


VIEW "B"

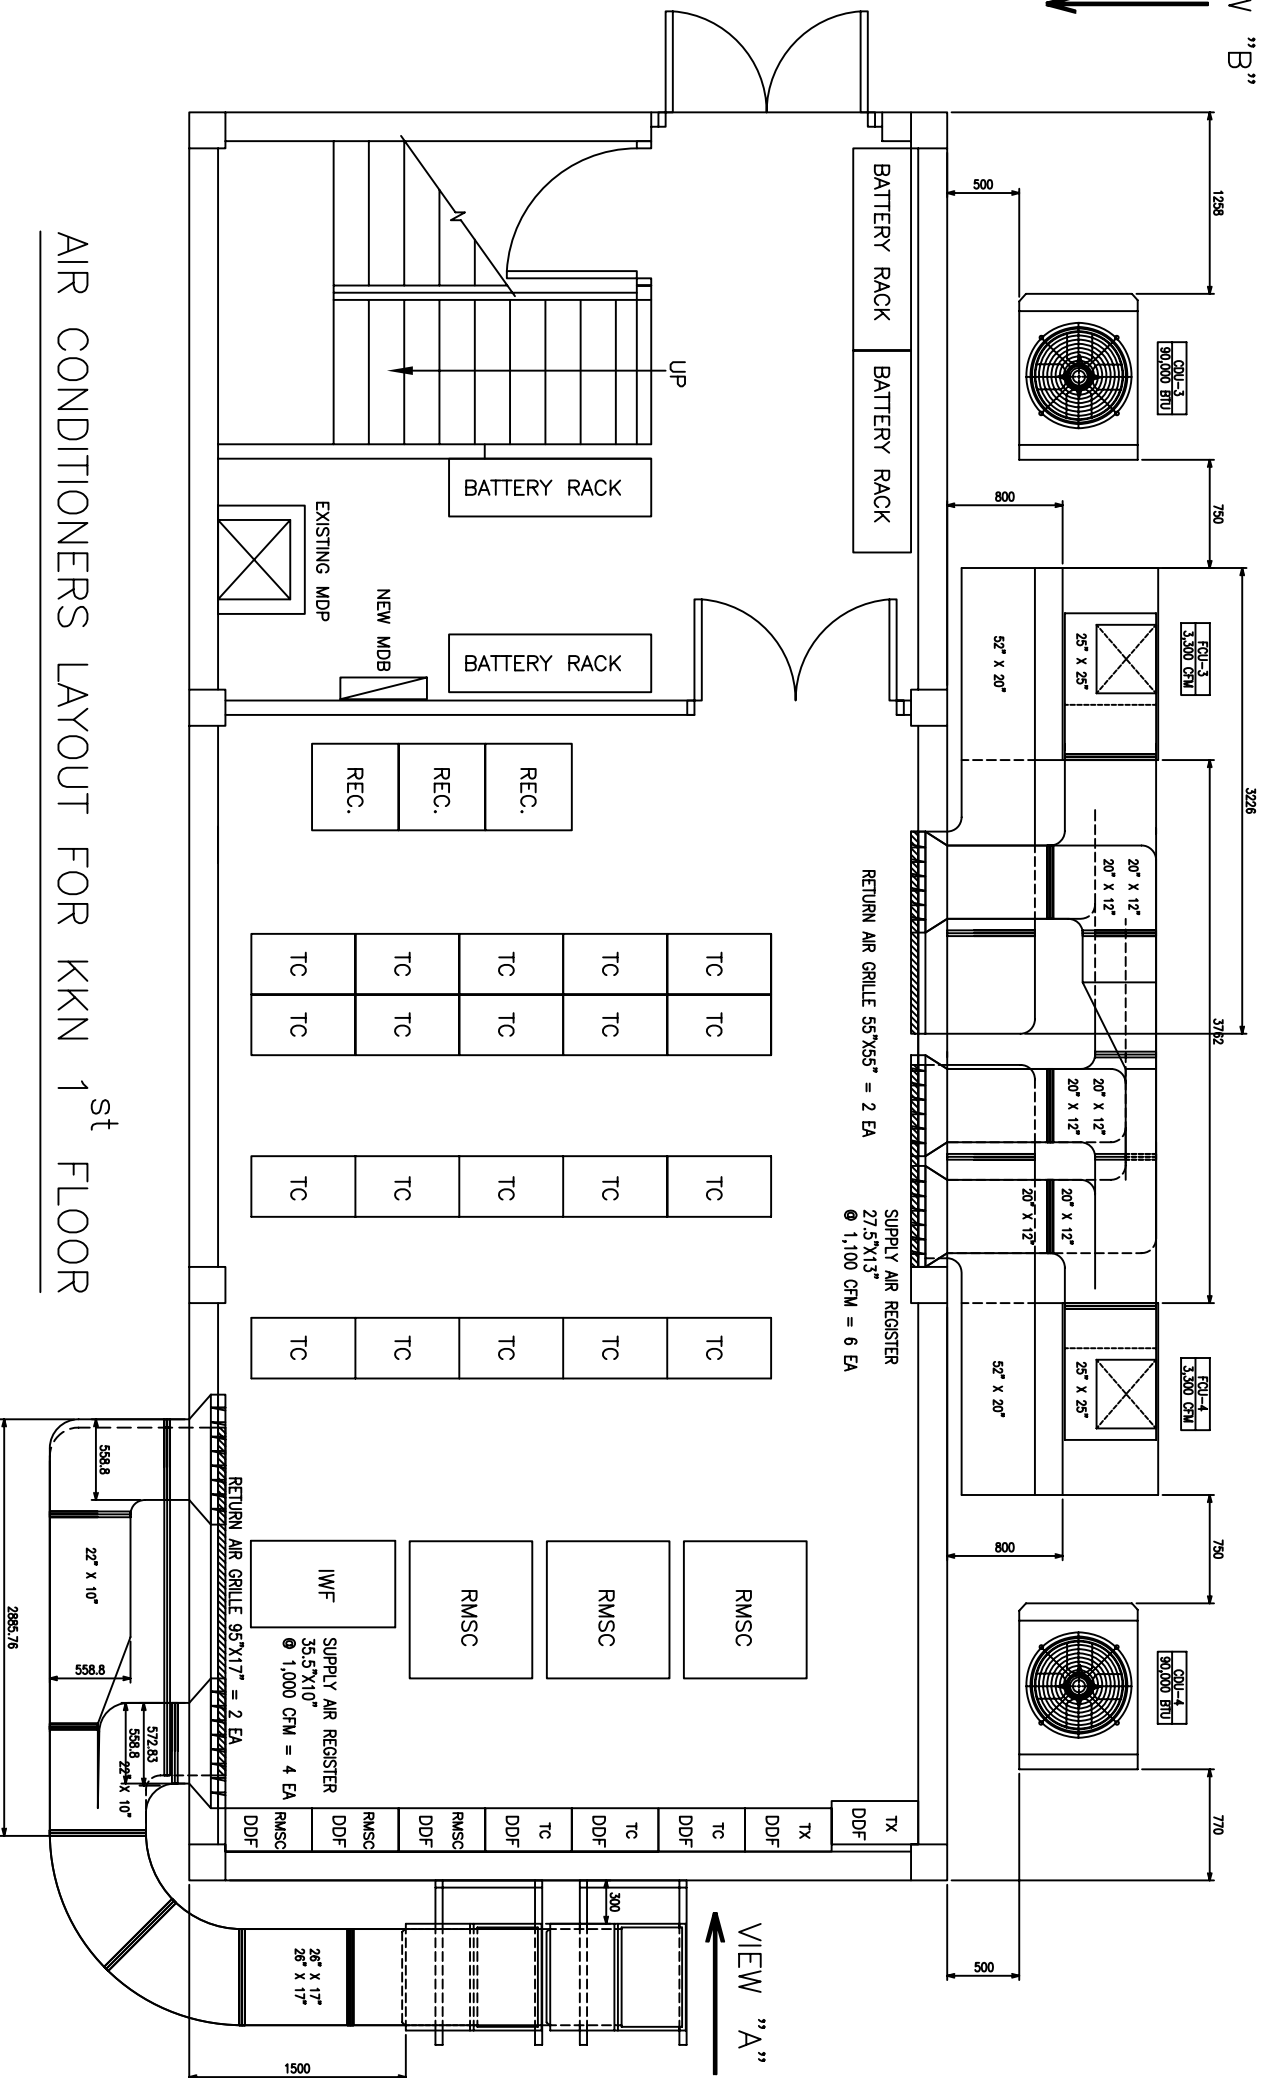

AIR CONDITIONERS LAYOUT FOR KKN 1st FLOOR

REVISION	
A	B

frue True Move Company Limited 18 True Tower, Ratchadaphisek Road, Huai Khwang, Bangkok 10310, Thailand		YORK INTERNATIONAL Air conditioning and Refrigeration (Thailand) Co., Ltd. 61-69 Omaha Rd, Suanluang Suburb, Bangkok 10250, Thailand		CAE Expert Solution to Air Conditioners COOL AIR ENGINEERING CO., LTD 1008 Suanmit01/1, Suanmit Road Bangkok Prachin, Bangkok 10260 TEL : 0-2746-3708, FAX : 0-2746-3709	
DIM LINE 		SCALE 		NO.	
04 F-8 : Change RAG from 95'x10" to 95'x17" : 11-October-2008		03 D-10, E-10 : Review Fancoil and Return Air Duct Position : 6-October-2008		02 B-5, B-6 : Review Return Air Duct Position : 6-October-2008	
DRAWN Paitiphorn R.		CHECKED Somvat S.		DESIGNED Paitiphorn R.	
APPROVED Komsun B.		AIR CONDITIONER SYSTEM RMSC KK		TRUE MOVE RMSC KK	
DNO0B002		1/3		1/3	